



CHANGE TYPE: Modification

CHANGE SUMMARY: Unless located beneath occupancy groups, Group S-2 enclosed parking garages now require automatic sprinkler protection only where the fire area containing the parking garage exceeds 12,000 square feet.

903.2.10


Sprinklers in Group S-2 Enclosed Parking Garages

2009 CODE: 903.2.9 903.2.10 Group S-2 Enclosed Parking Garages. An automatic sprinkler system shall be provided throughout buildings classified as enclosed parking garages in accordance with Section 406.4 ~~or where located beneath other groups~~ as follows:

1. Where the fire area of the enclosed parking garage exceeds 12,000 square feet (1115 m²); or
2. Where the enclosed parking garage is located beneath other groups.

Exception: (No change to text.)

903.2.10 continues

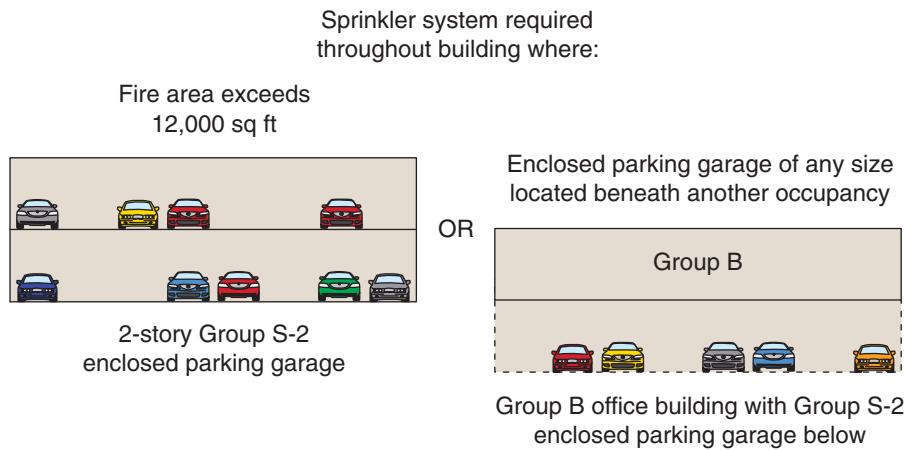

Sprinkler protection of Group S-2 enclosed parking garages

